



# CORRIDORS AND STAIRS

DPR n. 503 of 24/07/1996

## HANDRAIL REQUIREMENTS CORRIDORS

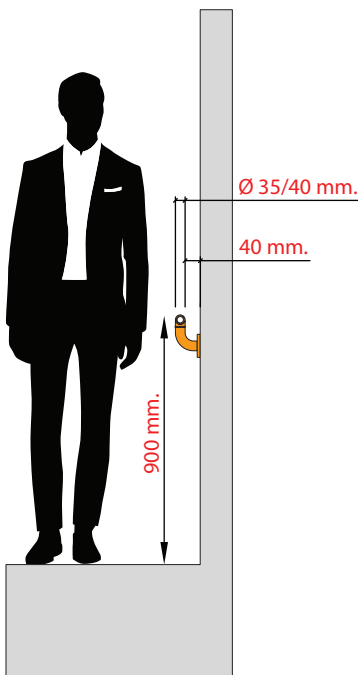

The corridors or paths must have a minimum width of 1000 mm. The handrail must be easily graspable with a diameter ranging from 35 to 40 mm. Between the handrail and the wall it is necessary to provide a distance of at least 40 mm. Furthermore it must be positioned at a height of 900 mm. high edge of the same. The support brackets must be fixed to the lower part of the handrail so as to allow easy sliding (see image on the side).

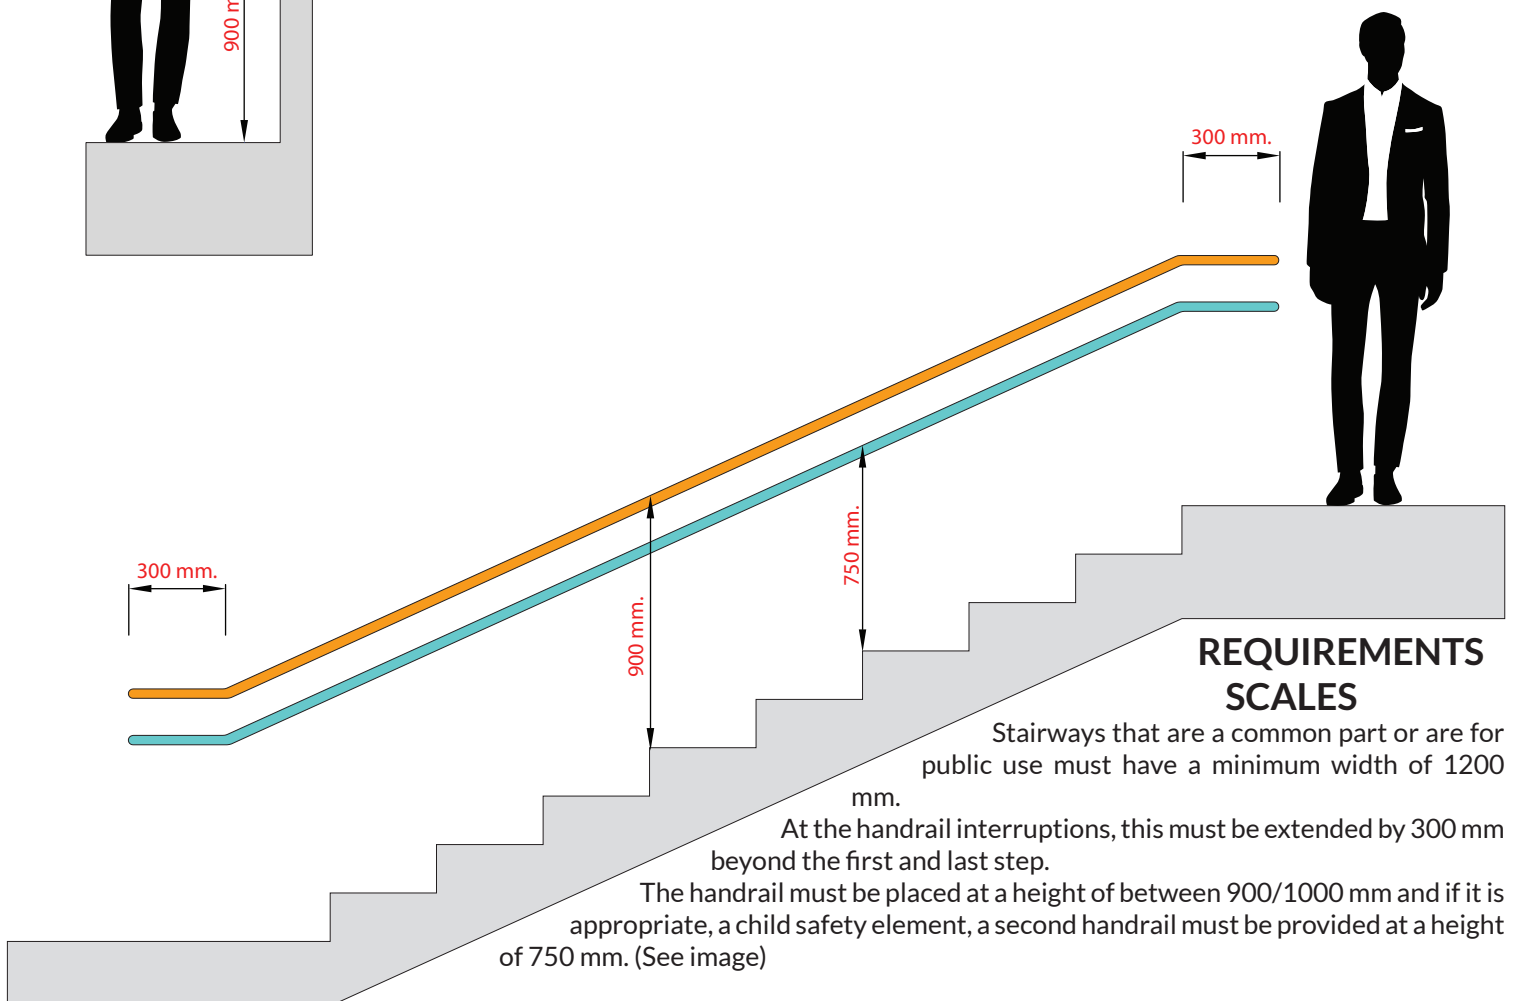

## REQUIREMENTS SCALES

Stairways that are a common part or are for public use must have a minimum width of 1200 mm.

At the handrail interruptions, this must be extended by 300 mm beyond the first and last step.

The handrail must be placed at a height of between 900/1000 mm and if it is appropriate, a child safety element, a second handrail must be provided at a height of 750 mm. (See image)